


\\DATA\ASB\DATA\PROJECTS\021.1270_Taos_Airport_ABEYTA_CONTRUCTION\CAD\PRODUCTION\ON SITE UTILITIES\C-2B INDEX OF AIRPORT WATER P AND P&DWG July 1, 2025 - 2:14 PM BY: ISABEL RODRIGUEZ

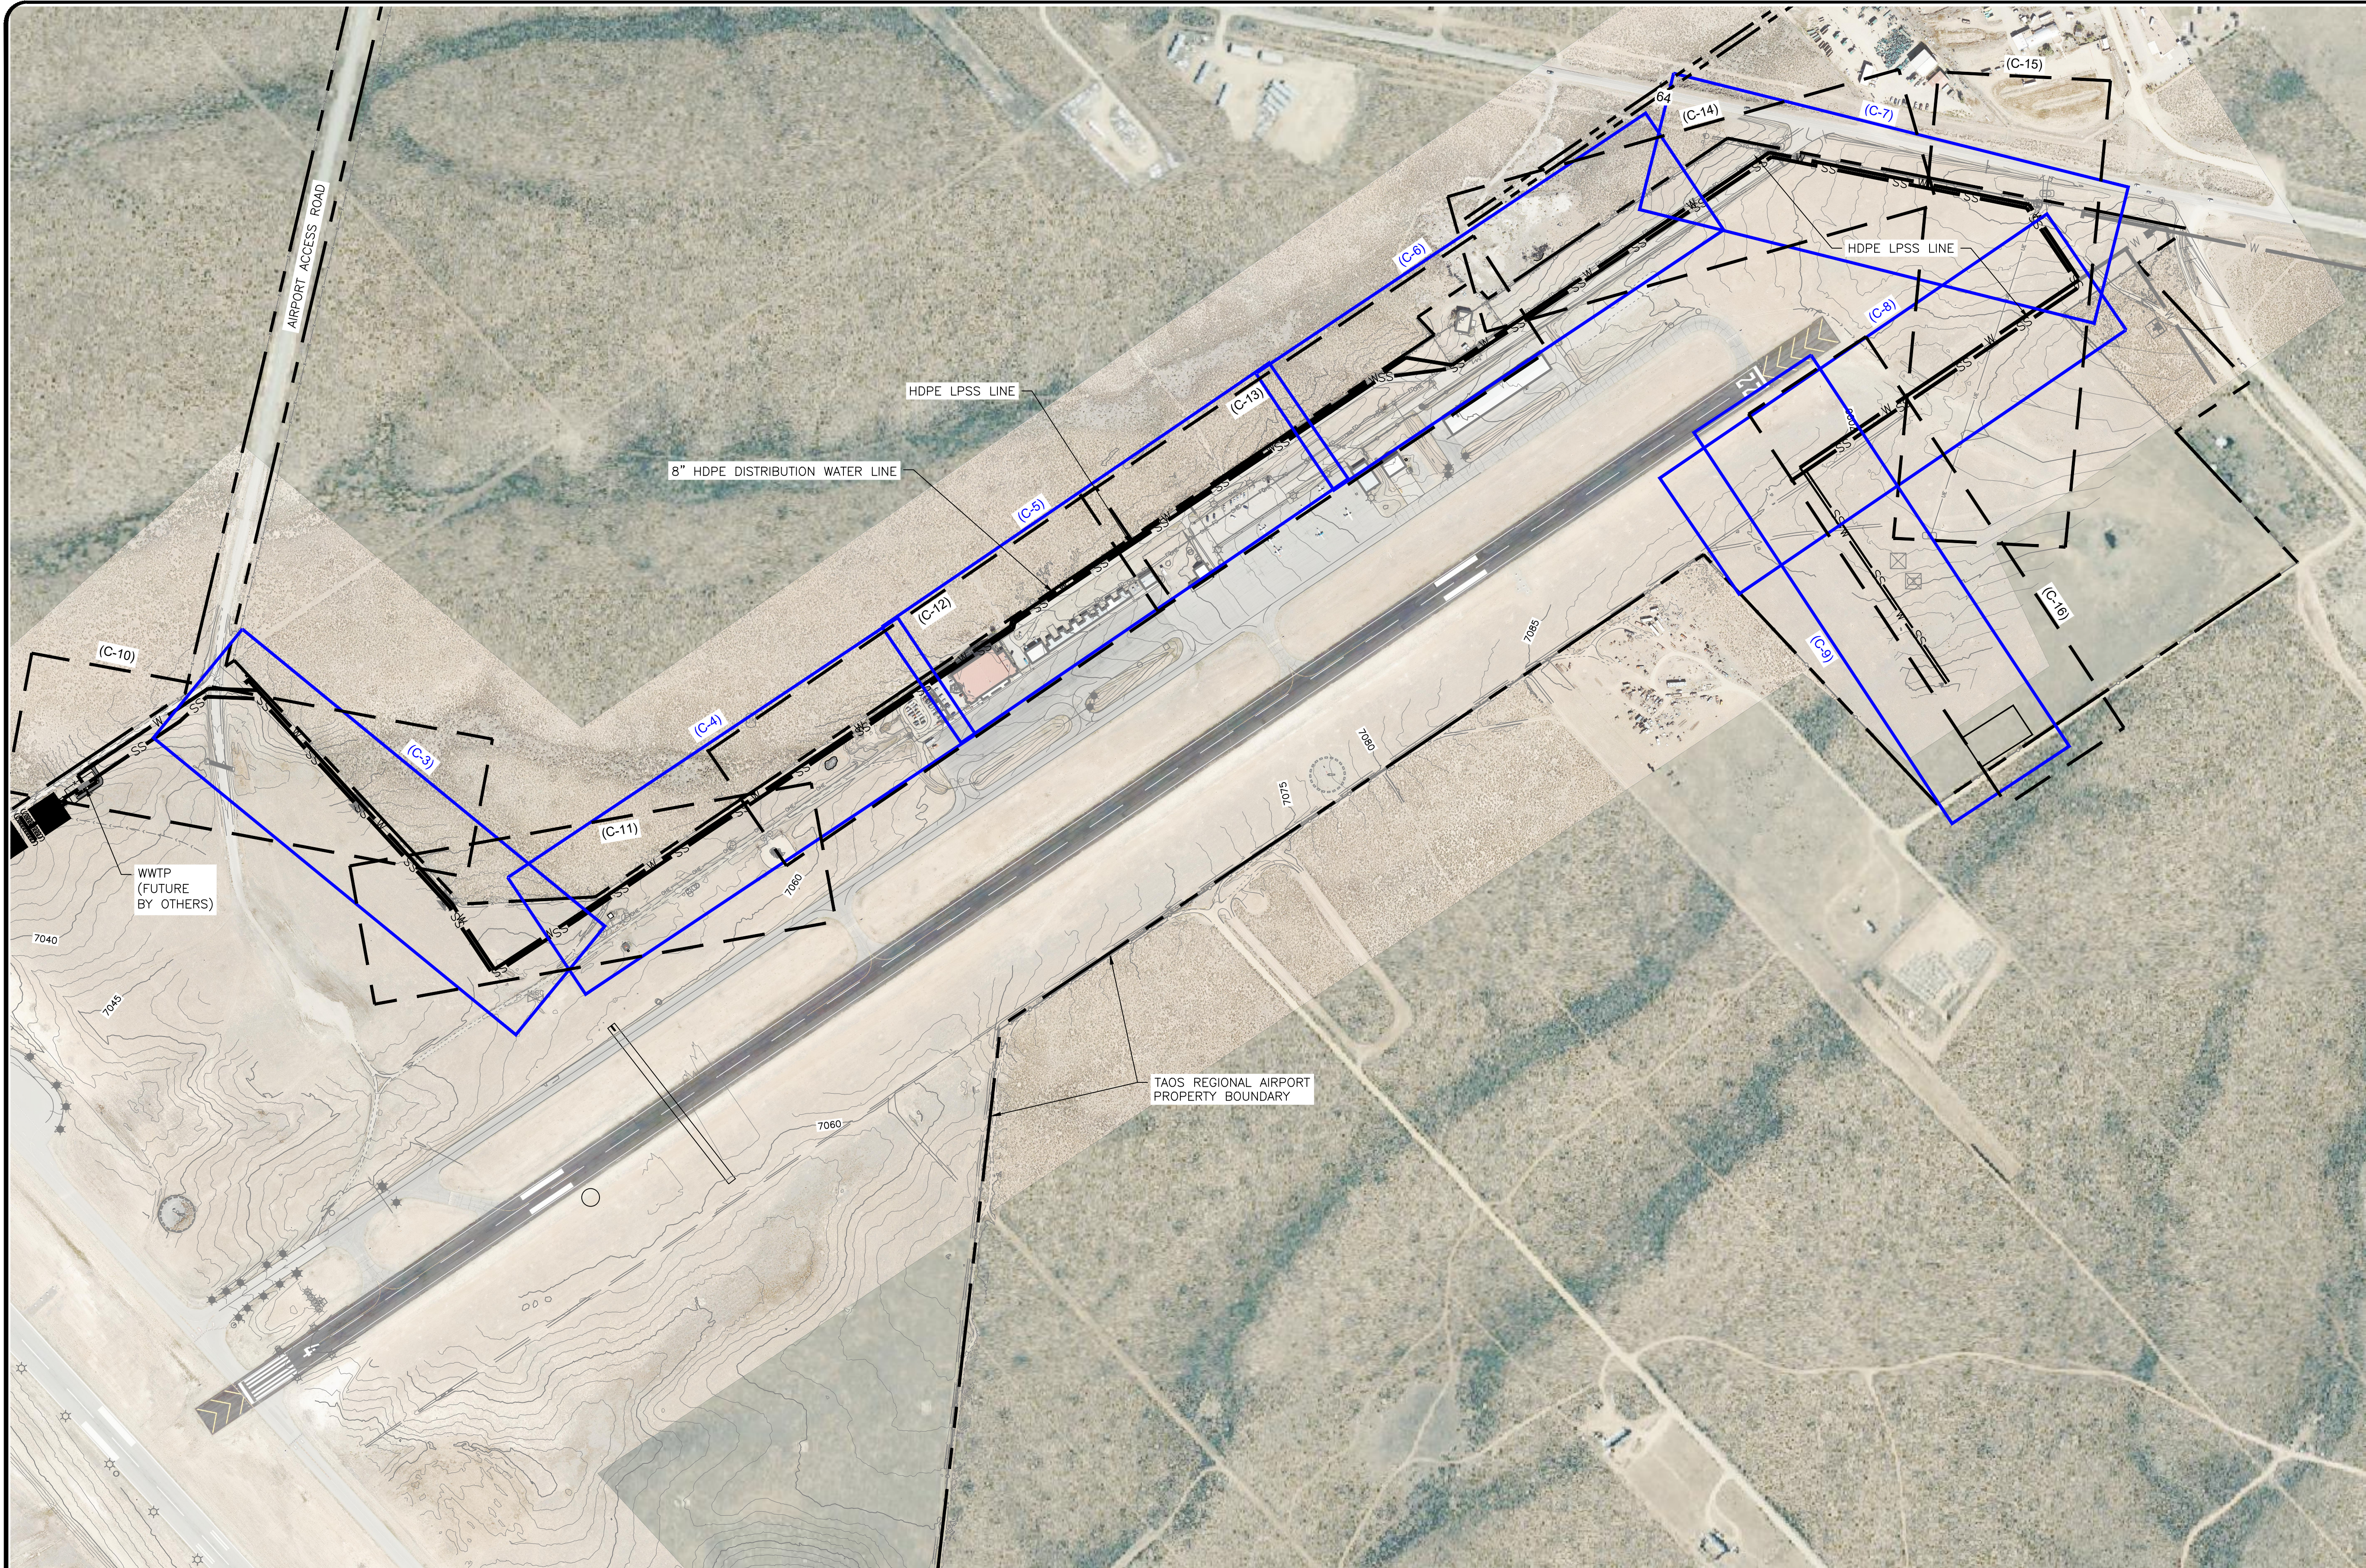

GENERAL NOTES:
1. ALL WORK ON AIRPORT PROPERTY TO BE COORDINATED WITH AIRPORT MANAGER.


LEGEND:

(C-3)

WATER LINE
P&P SHEET(S)

(C-10)

SEWER LINE
P&P SHEET(S)

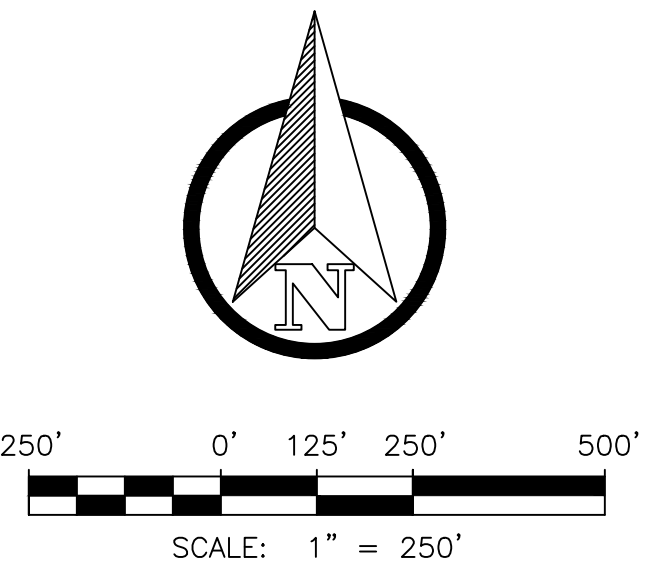

REV. NO.	DATE	DESCRIPTION	APPROVED BY
1	05/03/25	ISSUED FOR BID	GP

DATE OF ISSUE:	05/03/25
DESIGNED BY:	ANT
DRAWN BY:	RT, ANT
CHECKED BY:	GP
APPROVED BY:	GP



DBS&A
a Geo-Logic Company
6501 Americas Parkway NE Suite 200
Albuquerque, NM 87110




TOWN OF TAOS
TAOS COUNTY, NEW MEXICO
EDA 08-79-05544


TAOS REGIONAL AIRPORT WATER
AND WASTEWATER UTILITIES
TAOS COUNTY, NM
PLAN AND PROFILE INDEX

SHEET 6 OF 34
DWG NO. C-2B
JOB NO.
DB21.1270

\\DATA\ASB\DATA\PROJECTS\DB21.1270_Taos_Airport-ABETTA_CONSTRUCTION\CAD\PRODUCTION\ONSITE UTILITIES\C-3 - WATER P AND P 1.DWG July 1, 2025 - 2:14 PM BY: ISABEL RODRIGUEZ

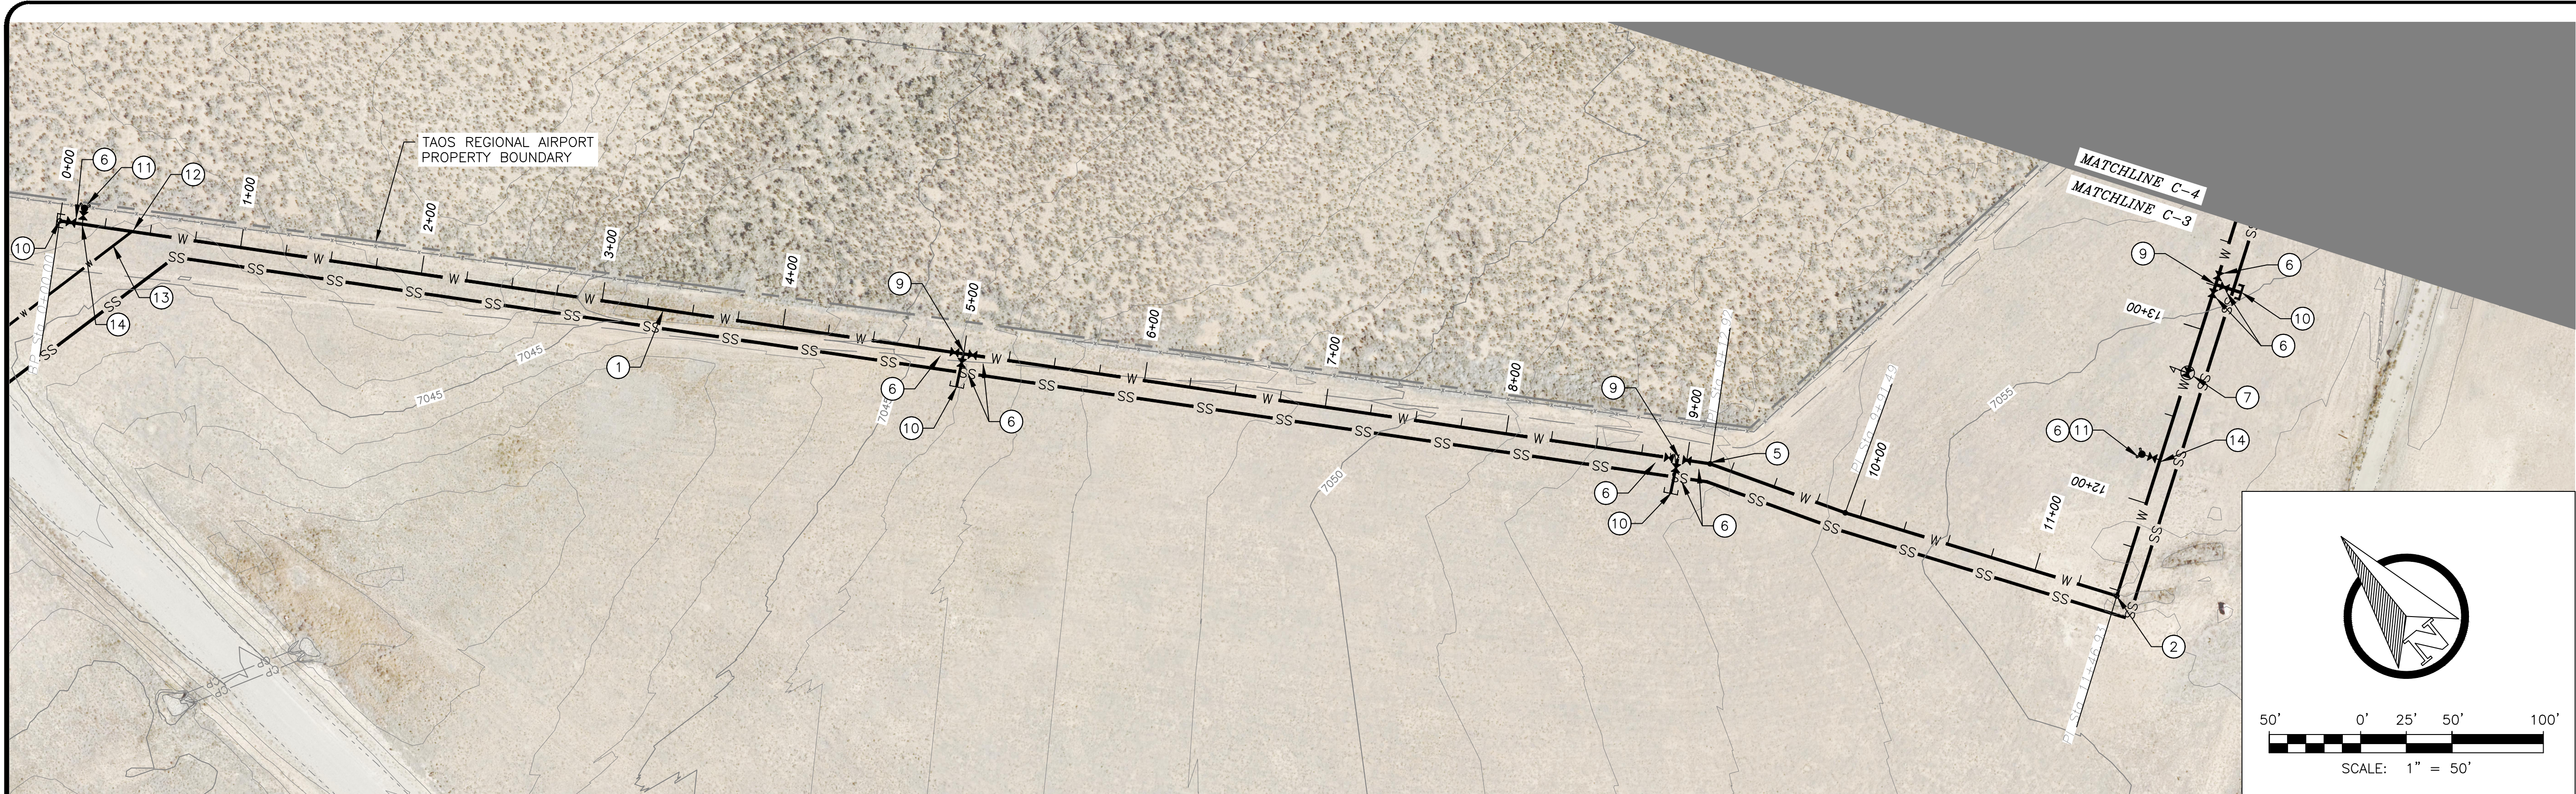

PLAN

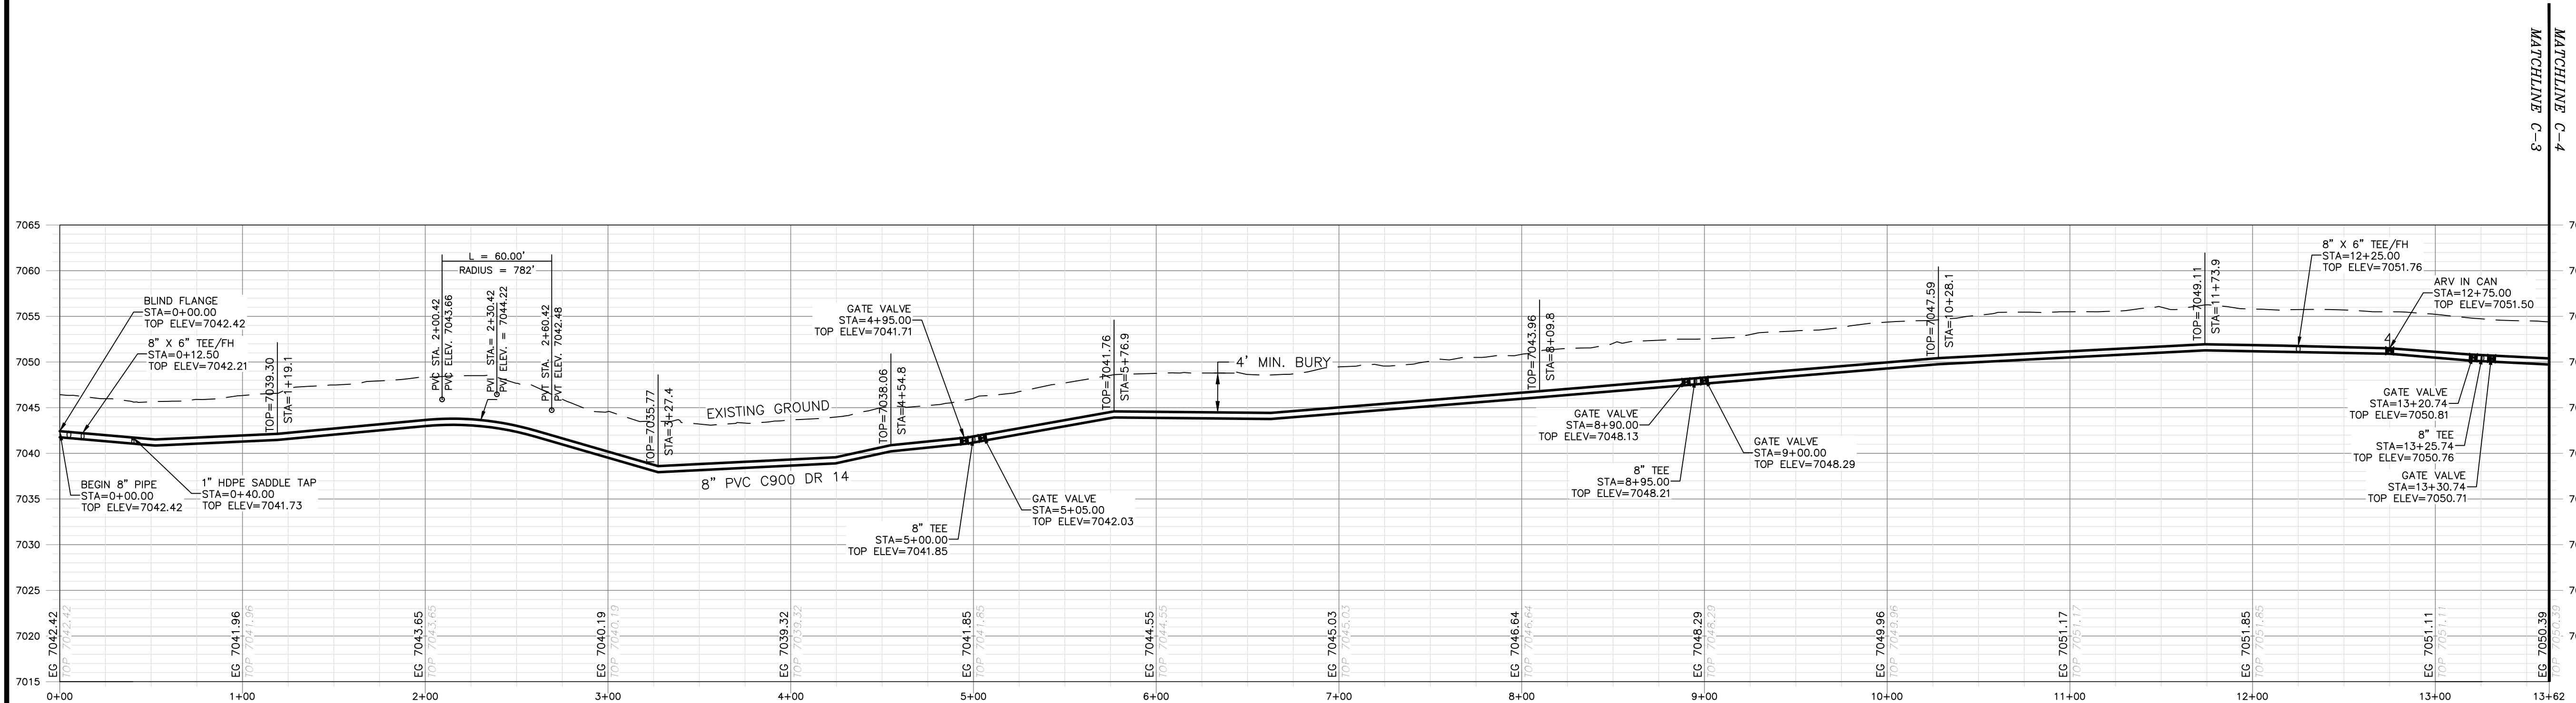

PROFILE

HORIZONTAL SCALE: 1"=50'
VERTICAL SCALE: 1"=10'

GENERAL NOTES:

1. CLEAR AND GRUB PIPE CORRIDOR (MIN 10' WIDTH) AND GRADE SMOOTH AFTER ALL CONSTRUCTION.
2. MINIMUM PIPE BURIAL SHALL BE 4' TO TOP OF PIPE.
3. EXISTING UTILITIES SHOWN ARE APPROXIMATE. CONTRACTOR TO CONTACT APPROPRIATE UTILITY JURISDICTION AND POTHOLE EXISTING UTILITIES AS REQUIRED TO AVOID CONFLICTS.
4. MAINTAIN 6' CLEARANCE BETWEEN EXISTING ROAD EDGE OF PAVEMENT AND WATERLINE TRENCH EXCAVATION UNLESS OTHERWISE NOTED.
5. PIPELINE CROSSINGS OF ROADWAYS AND DRIVEWAYS SHALL BE IN ACCORDANCE WITH NM PUBLIC WORKS STANDARDS.
6. MAINTAIN 10' HORIZONTAL AND 1.5' VERTICAL CLEARANCE BETWEEN WATERLINES AND SEWER FORCE MAIN.
7. PIPE RESTRAINT PER DETAIL 3, DWG C-21

KEY NOTES:

- ① 8" DR 18 C900 PVC LINE PER DETAIL 1, DWG C-18
- ② 90-DEGREE BEND
- ③ 45-DEGREE BEND
- ④ 22.5-DEGREE BEND
- ⑤ 11.25-DEGREE BEND
- ⑥ GATE VALVE IN CAN PER DETAIL 3, DWG C-18
- ⑦ AIR RELEASE VALVE IN VAULT PER DETAIL 2, DWG C-20
- ⑧ UTILITY CROSSING
- ⑨ 8" DR 18 TEE
- ⑩ BLIND FLANGE
- ⑪ FIRE HYDRANT PER DETAIL 1, DWG C-20
- ⑫ 1" DR SADDLE TAP
- ⑬ 1" DR 18 HDPE WATER SERVICE LINE
- ⑭ 8" X 6" DR 18 TEE

REV. NO.	DATE	DESCRIPTION	APPROVED BY
①	05/03/25	ISSUED FOR BID	GP
②	07/02/25	REVISED KEY NOTES	GP

DATE OF ISSUE: 07/02/2025
DESIGNED BY: ANT
DRAWN BY: RT, ANT
CHECKED BY: GP
APPROVED BY: GP



TOWN OF TAOS
TAOS COUNTY, NEW MEXICO
EDA 08-79-05544


TAOS REGIONAL AIRPORT WATER
AND WASTEWATER UTILITIES
TAOS COUNTY, NM

PLAN AND PROFILE 1 - WATER


SHEET 7 OF 34
DWG NO. C-3

JOB NO.
DB21.1270

\\DATA\ASB\DATA\PROJECTS\DB21.1270_TAO Regional Airport Water and Wastewater Utilities\DWG C-4 - WATER P AND P 2.DWG July 1, 2025 - 2:14 PM BY: ISABEL RODRIGUEZ

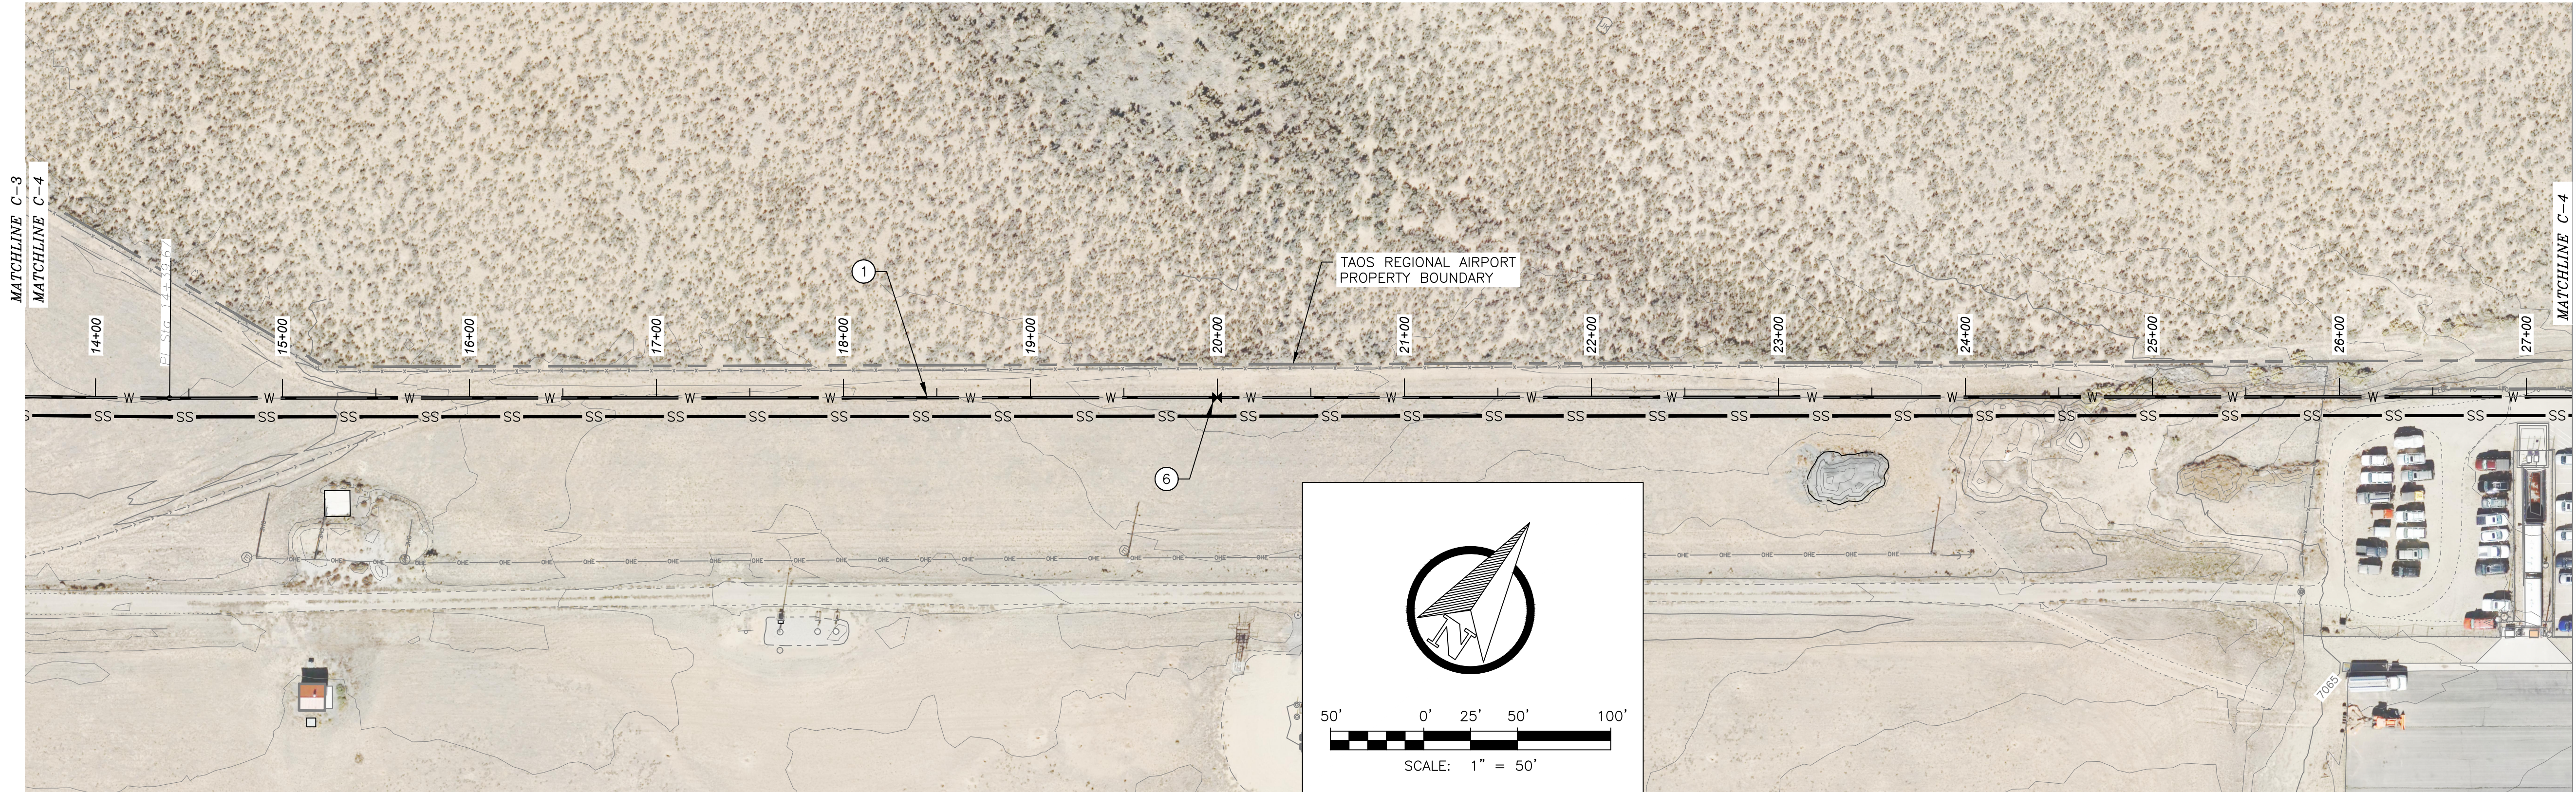

PLAN

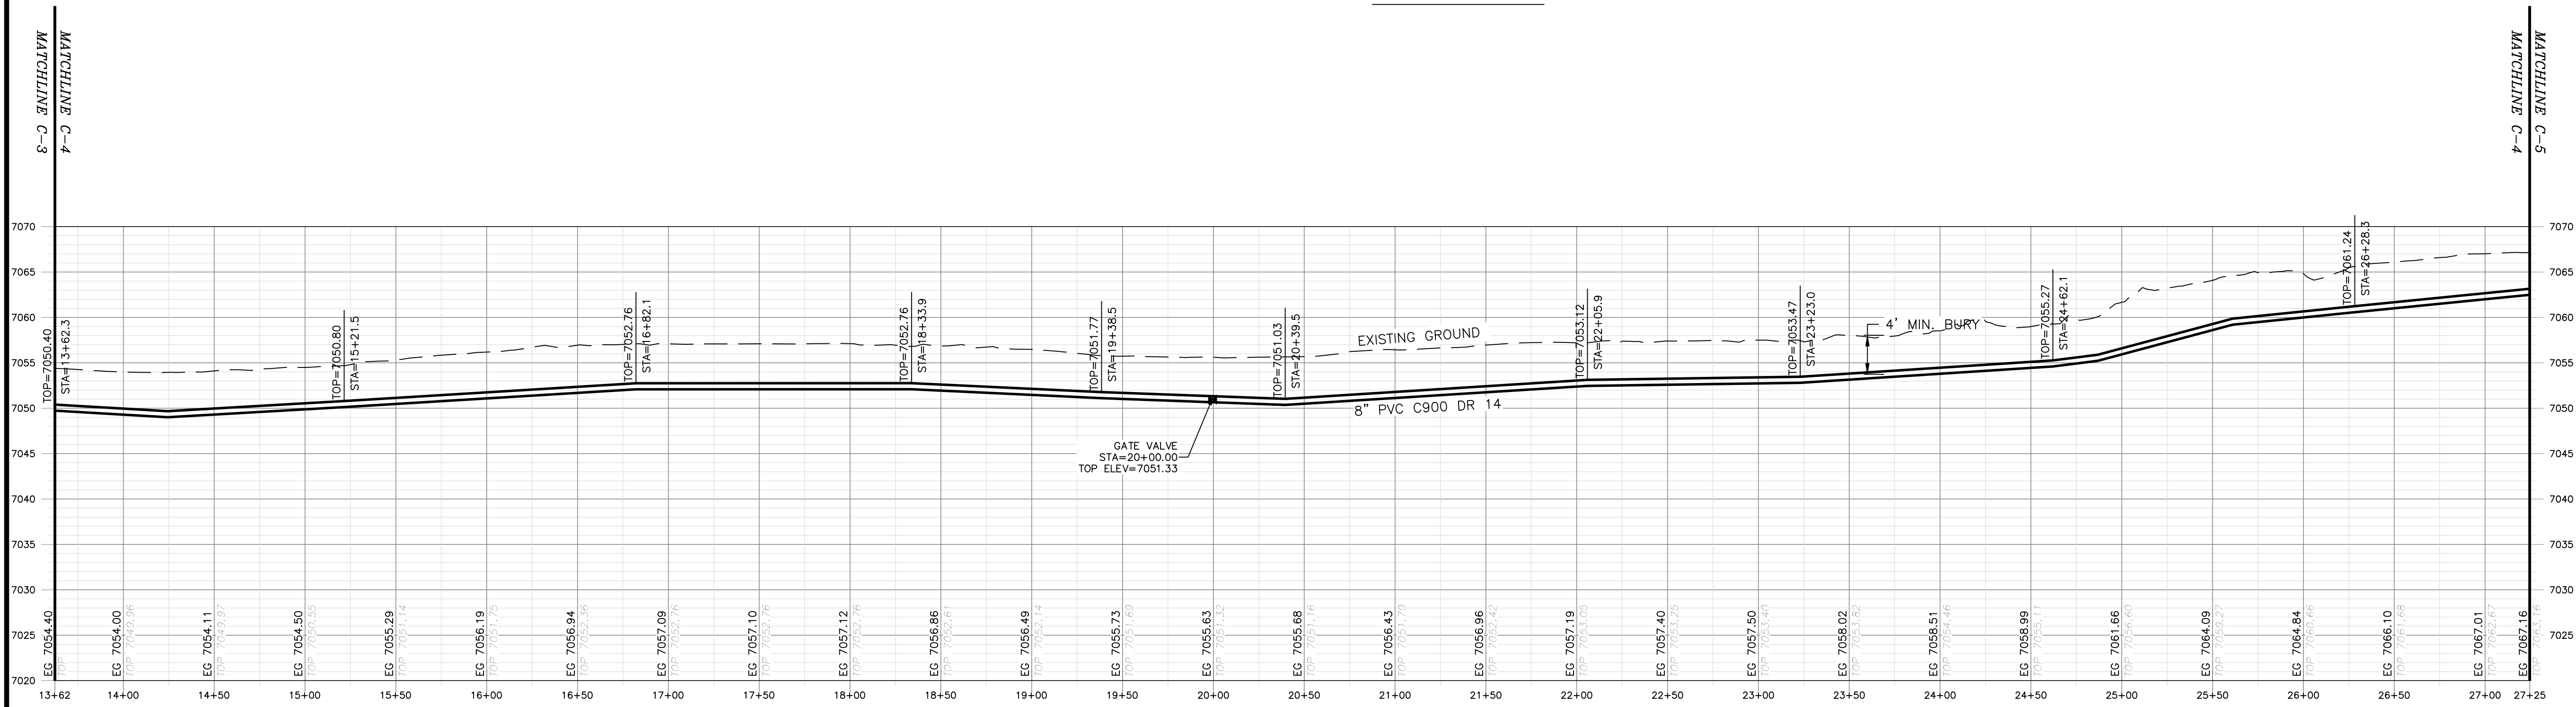

PROFILE

HORIZONTAL SCALE: 1"=50'
VERTICAL SCALE: 1"=10'

GENERAL NOTES:

- CLEAR AND GRUB PIPE CORRIDOR (MIN 10' WIDTH) AND GRADE SMOOTH AFTER ALL CONSTRUCTION.
- MINIMUM PIPE BURIAL SHALL BE 4' TO TOP OF PIPE.
- EXISTING UTILITIES SHOWN ARE APPROXIMATE. CONTRACTOR TO CONTACT APPROPRIATE UTILITY JURISDICTION AND POTHOLE EXISTING UTILITIES AS REQUIRED TO AVOID CONFLICTS.
- MAINTAIN 6' CLEARANCE BETWEEN EXISTING ROAD EDGE OF PAVEMENT AND WATERLINE TRENCH EXCAVATION UNLESS OTHERWISE NOTED.
- PIPELINE CROSSINGS OF ROADWAYS AND DRIVEWAYS SHALL BE IN ACCORDANCE WITH NM PUBLIC WORKS STANDARDS.
- MAINTAIN 10' HORIZONTAL AND 1.5' VERTICAL CLEARANCE BETWEEN WATERLINES AND SEWER FORCE MAIN.
- PIPE RESTRAINT PER DETAIL 3, DWG C-21

KEY NOTES:

- 8" DR 18 C900 PVC LINE PER DETAIL 1, DWG C-18
- 90-DEGREE BEND
- 45-DEGREE BEND
- 22.5-DEGREE BEND
- 11.25-DEGREE BEND
- GATE VALVE IN CAN PER DETAIL 3, DWG C-18
- AIR RELEASE VALVE IN VAULT PER DETAIL 2, DWG C-20
- UTILITY CROSSING
- 8" DR 18 TEE
- BLIND FLANGE
- FIRE HYDRANT PER DETAIL 1, DWG C-20
- 1" DR SADDLE TAP
- 1" DR 18 HDPE WATER SERVICE LINE
- 8" X 6" DR 18 TEE

REV. NO.	DATE	DESCRIPTION	APPROVED BY
1	05/03/25	ISSUED FOR BID	GP
2	07/02/25	REVISED KEY NOTES	GP

DATE OF ISSUE: 07/02/2025
DESIGNED BY: ANT
DRAWN BY: RT, ANT
CHECKED BY: GP
APPROVED BY: GP



TOWN OF TAO
TAOS COUNTY, NEW MEXICO
EDA 08-79-05544

TAOS REGIONAL AIRPORT WATER
AND WASTEWATER UTILITIES
TAOS COUNTY, NM

PLAN AND PROFILE 2 - WATER

SHEET 8 OF 34
DWG NO. C-4

JOB NO.
DB21.1270

\\DATA\ASB\DATA\PROJECTS\DB21.1270_TAOs_AIRPORT-ABETA_CONSTRUCTION\CAD\PRODUCTION\ONSITE UTILITIES\C-5 - WATER P AND P 3.DWG July 1, 2025 - 2:14 PM BY: ISABEL RODRIGUEZ




GENERAL NOTES:

- CLEAR AND GRUB PIPE CORRIDOR (MIN 10' WIDTH) AND GRADE SMOOTH AFTER ALL CONSTRUCTION.
- MINIMUM PIPE BURIAL SHALL BE 4' TO TOP OF PIPE.
- EXISTING UTILITIES SHOWN ARE APPROXIMATE. CONTRACTOR TO CONTACT APPROPRIATE UTILITY JURISDICTION AND POTHOLE EXISTING UTILITIES AS REQUIRED TO AVOID CONFLICTS.
- MAINTAIN 6' CLEARANCE BETWEEN EXISTING ROAD EDGE OF PAVEMENT AND WATERLINE TRENCH EXCAVATION UNLESS OTHERWISE NOTED.
- PIPELINE CROSSINGS OF ROADWAYS AND DRIVEWAYS SHALL BE IN ACCORDANCE WITH NM PUBLIC WORKS STANDARDS.
- MAINTAIN 10' HORIZONTAL AND 1.5' VERTICAL CLEARANCE BETWEEN WATERLINES AND SEWER FORCE MAIN.
- PIPE RESTRAINT PER DETAIL 3, DWG C-21

KEY NOTES:

- 8" DR 18 C900 PVC LINE PER DETAIL 1, DWG C-18
- 90-DEGREE BEND
- 45-DEGREE BEND
- 22.5-DEGREE BEND
- 11.25-DEGREE BEND
- GATE VALVE IN CAN PER DETAIL 3, DWG C-18
- AIR RELEASE VALVE IN VAULT PER DETAIL 2, DWG C-20
- UTILITY CROSSING
- 8" DR 18 TEE
- BLIND FLANGE
- FIRE HYDRANT PER DETAIL 1, DWG C-20
- 1" DR SADDLE TAP
- 1" DR 18 HDPE WATER SERVICE LINE
- 8" X 6" DR 18 TEE

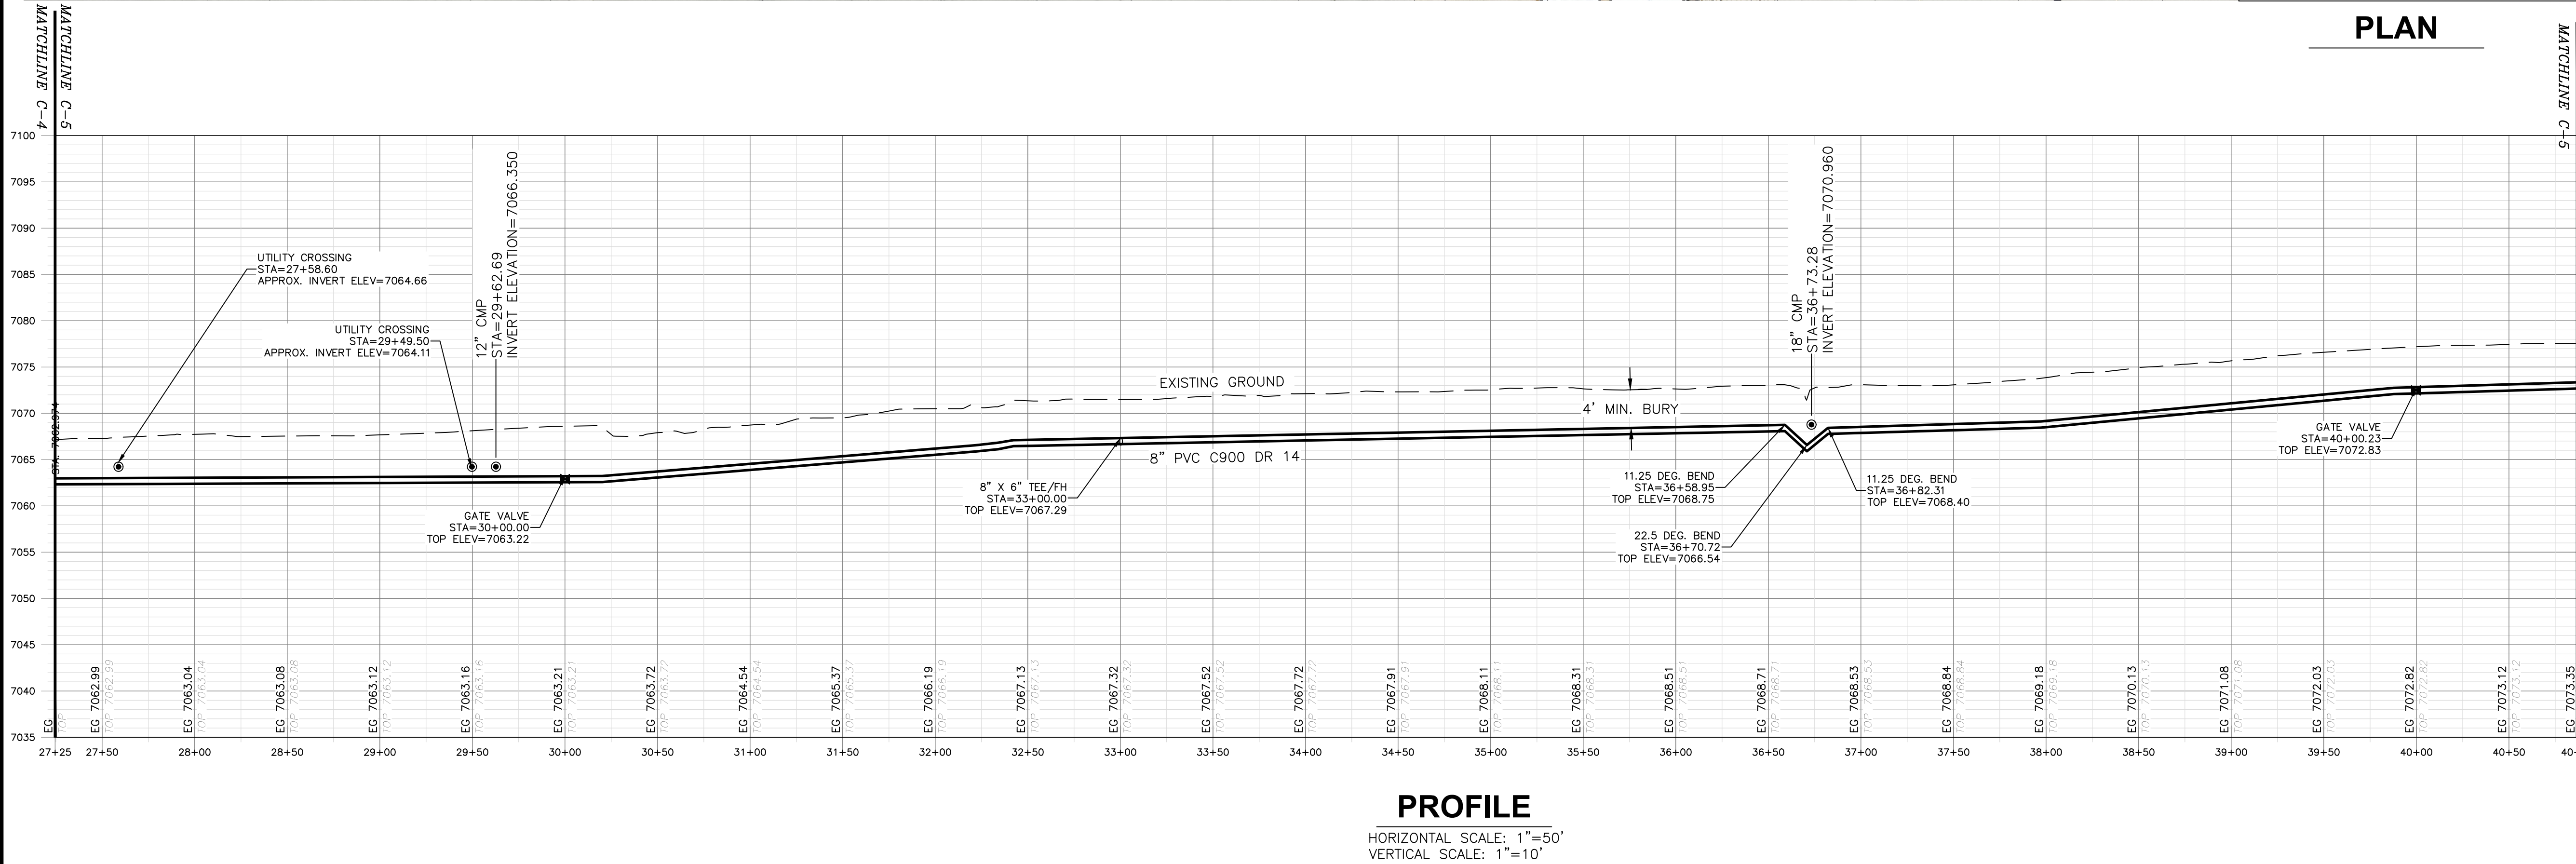

REV. NO.	DATE	DESCRIPTION	APPROVED BY
1	05/03/25	ISSUED FOR BID	GP
2	07/02/25	REVISED KEY NOTES	GP

DATE OF ISSUE: 07/02/2025
DESIGNED BY: ANT
DRAWN BY: RT, ANT
CHECKED BY: GP
APPROVED BY: GP



TOWN OF TAOs
TAOS COUNTY, NEW MEXICO
EDA 08-79-05544

TAOS REGIONAL AIRPORT WATER
AND WASTEWATER UTILITIES
TAOS COUNTY, NM

PLAN AND PROFILE 3 - WATER


SHEET 9 OF 34
DWG NO. C-5

JOB NO.
DB21.1270

\\DATA\ASB\DATA\PROJECTS\DB21.1270_TAO Regional Airport\ABETA_CONTRUCTION\CAD\PRODUCTION\ON SITE UTILITIES\C-6 - WATER P AND P 4.DWG July 1, 2025 - 2:14 PM BY: ISABEL RODRIGUEZ



PLAN

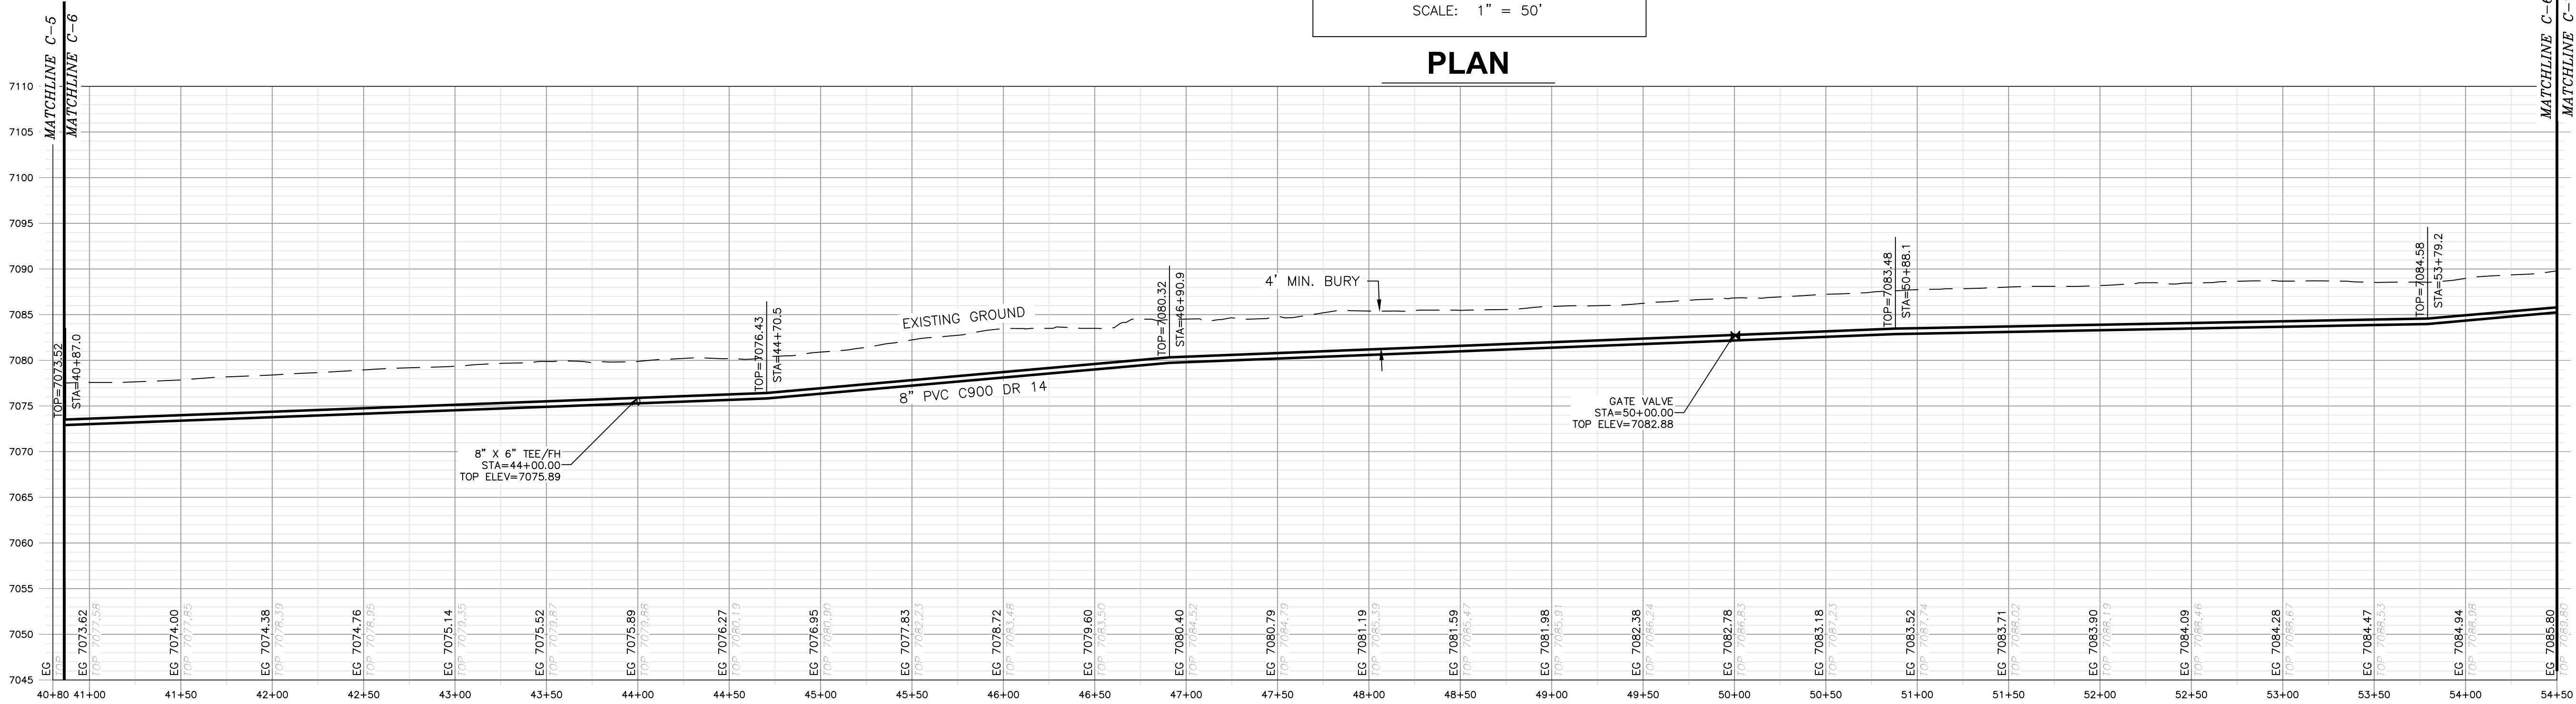

PROFILE

HORIZONTAL SCALE: 1"=50'
VERTICAL SCALE: 1"=10'

GENERAL NOTES:

1. CLEAR AND GRUB PIPE CORRIDOR (MIN 10' WIDTH) AND GRADE SMOOTH AFTER ALL CONSTRUCTION.
2. MINIMUM PIPE BURIAL SHALL BE 4' TO TOP OF PIPE.
3. EXISTING UTILITIES SHOWN ARE APPROXIMATE. CONTRACTOR TO CONTACT APPROPRIATE UTILITY JURISDICTION AND POTHOLE EXISTING UTILITIES AS REQUIRED TO AVOID CONFLICTS.
4. MAINTAIN 6' CLEARANCE BETWEEN EXISTING ROAD EDGE OF PAVEMENT AND WATERLINE TRENCH EXCAVATION UNLESS OTHERWISE NOTED.
5. PIPELINE CROSSINGS OF ROADWAYS AND DRIVEWAYS SHALL BE IN ACCORDANCE WITH NM PUBLIC WORKS STANDARDS.
6. MAINTAIN 10' HORIZONTAL AND 1.5' VERTICAL CLEARANCE BETWEEN WATERLINES AND SEWER FORCE MAIN.
7. PIPE RESTRAINT PER DETAIL 3, DWG C-21

KEY NOTES:

- ① 8" DR 18 C900 PVC LINE PER DETAIL 1, DWG C-18
- ② 90-DEGREE BEND
- ③ 45-DEGREE BEND
- ④ 22.5-DEGREE BEND
- ⑤ 11.25-DEGREE BEND
- ⑥ GATE VALVE IN CAN PER DETAIL 3, DWG C-18
- ⑦ AIR RELEASE VALVE IN VAULT PER DETAIL 2, DWG C-20
- ⑧ UTILITY CROSSING
- ⑨ 8" DR 18 TEE
- ⑩ BLIND FLANGE
- ⑪ FIRE HYDRANT PER DETAIL 1, DWG C-20
- ⑫ 1" DR SADDLE TAP
- ⑬ 1" DR 18 HDPE WATER SERVICE LINE
- ⑭ 8" X 6" DR 18 TEE

REV. NO.	DATE	DESCRIPTION	APPROVED BY
①	05/03/25	ISSUED FOR BID	GP
②	07/02/25	REVISED KEY NOTES	GP

DATE OF ISSUE: 07/02/2025
DESIGNED BY: ANT
DRAWN BY: RT, ANT
CHECKED BY: GP
APPROVED BY: GP



TOWN OF TAO
TAOS COUNTY, NEW MEXICO
EDA 08-79-05544

TAOS REGIONAL AIRPORT WATER
AND WASTEWATER UTILITIES
TAOS COUNTY, NM

PLAN AND PROFILE 4 - WATER

SHEET 10 OF 34
DWG NO. C-6

JOB NO.
DB21.1270